

Fluid Cooling Industrial RM Series

Performance Notes

- Mounts behind existing TEFC motor for compact, low cost application
- Utilizes electric motor fan air flow
- Ideal for case drain and low flow applications
- Protected core
- Compact, efficient design
- Low flow & heat removal
- SAE, NPT or metric conversion
- Mounting brackets included



Ratings

Maximum Operating Pressure
300 PSI

Test Pressure
300 PSI

Maximum Operating Temperature
350°F

Materials

Tubes Copper

Fins Aluminum

Turbulators Aluminum

Cabinet Steel with powder coat finish

Filter Stainless frame with washable media

Manifolds Copper (RM-08)
Steel (RM-19 & RM-24)

Connections Brass (RM-08)
Steel (RM-19 & RM-24)

Nameplate Aluminum

How to Order (RM-08 models only)

RM	-	0	8	-		-	
Model Series		Model Size Selected			Number of Passes		Connection Type
					1 - 1 Pass		1 - NPT
					2 - 2 Pass		2 - SAE
					4 - 4 Pass		3 - BSPP
							Optional Bypass*
							Blank - No Bypass
							30 - 30 PSI
							60 - 60 PSI

*Bypass not available in Four Pass.
60 PSI only on Two Pass
30 or 60 PSI on One Pass

This is a partial flow pressure bypass only. It is not designed to be a full flow system bypass.

How to Order (All models except RM-08 size)


RM	-			-		-	
Model Series		Model Size Selected			Number of Passes		Connection Type
					1 - 1 Pass		1 - NPT
					2 - 2 Pass		2 - SAE
							3 - BSPP
							Optional Bypass*
							Blank - No Bypass
							30 - 30 PSI
							60 - 60 PSI

*Available on One Pass only


This is a partial flow pressure bypass only. It is not designed to be a full flow system bypass.

Dimensions


RM-08-1 One Pass

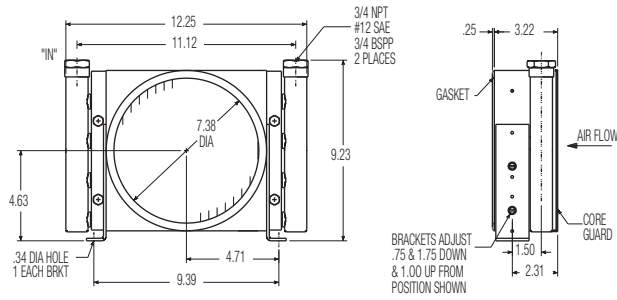


RM-08-2 Two Pass

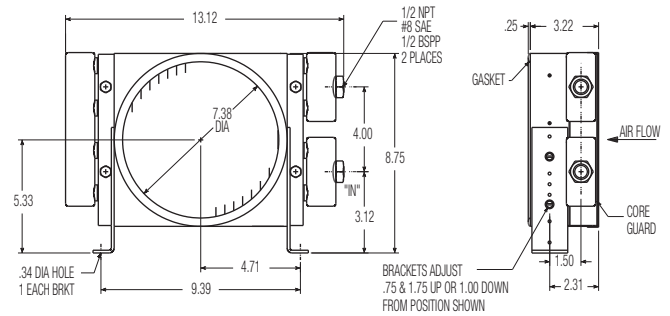


RM-08-4 Four Pass

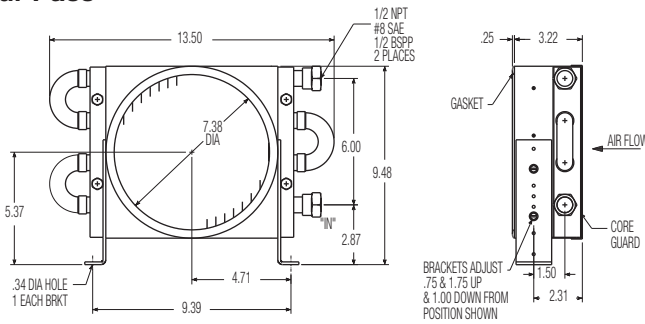

RM-19-1, RM-24-1 One Pass

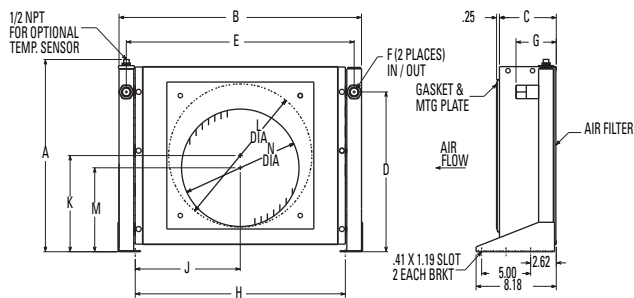


RM-19-2, RM-24-2 Two Pass

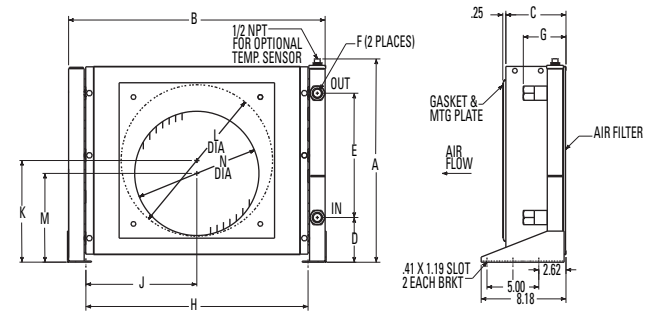

Model	A	B	C	D	E	F		G		H	J	K	L	M	N	Weight LBS
						SAE	NPT & BSPP	SAE	NPT & BSPP							
RM-19-1	13.62	16.00	5.11	10.31	15.00	#12	.75	3.05	4.12	13.96	7.38	6.81	10.38	5.81	7.50	16
RM-19-2	13.62	16.50	5.11	4.31	6.00	#12	.75	3.05	4.12	13.96	7.38	6.81	10.31	5.81	7.50	16
RM-24-1	19.62	24.75	5.85	16.31	23.25	#12	.75	3.05	4.12	21.44	10.72	9.81	14.62	8.56	12.00	31
RM-24-2	19.62	24.75	5.85	4.31	12.00	#12	.75	3.05	4.12	21.44	10.72	9.81	14.62	8.56	12.00	31

NOTE: All dimensions in inches. We reserve the right to make reasonable design changes without notice.

Performance Curves

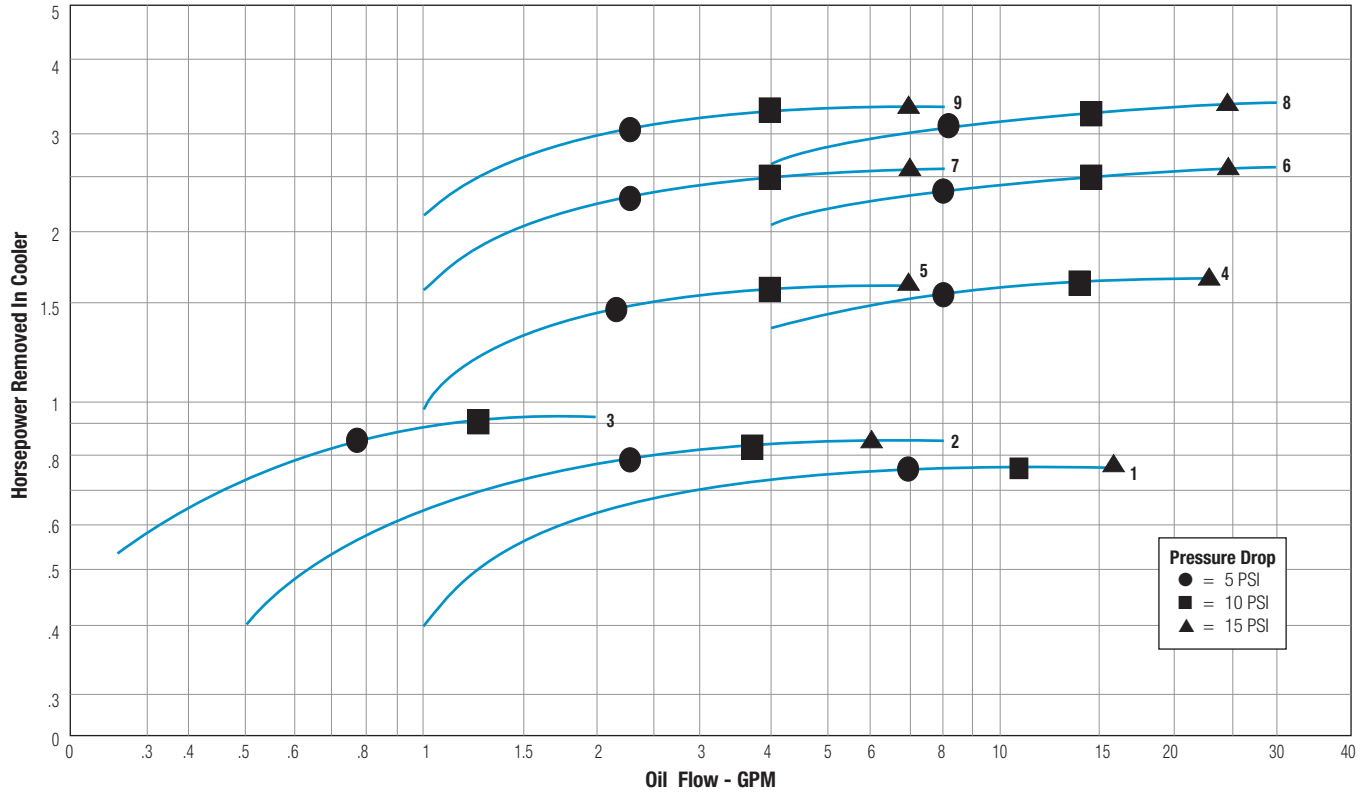

Selection Procedure

Performance Curves are based on 50SSU oil leaving the cooler 40°F higher than the ambient air temperature used for cooling and 1800 RPM motor speed. This is also referred to as a 40° approach temperature.

STEP 1 Determine the Heat Load. This will vary with different systems, but typically coolers are sized to remove 25 to 50% of the input nameplate horsepower.

(Example: 100 HP Power Unit x .33 = 33 HP Heat load. For 1200 RPM motors, multiply Heat Load by 1.5.)

If BTU/HR is known: $HP = \frac{BTU/HR}{2545}$

STEP 2 Determine Approach Temperature.

Desired oil leaving cooler °F – Ambient air temp.
°F = Actual Approach

STEP 3 Determine Curve Horsepower Heat Load. Enter the information from above:

Horsepower heat load x $\frac{40 \times Cv}{\text{Actual Approach}}$ = Curve Horsepower

STEP 4 Enter curves at oil flow through cooler and curve horsepower. Any curve above the intersecting point will work.

STEP 5 Determine Oil Pressure Drop from Curves:

● = 5 PSI ■ = 10 PSI ▲ = 20 PSI Multiply pressure drop from curve by correction factor found in oil ΔP correction curve.

Desired Reservoir Temperature

Return Line Cooling: Desired temperature is the oil temperature leaving the cooler. This will be the same temperature that will be found in the reservoir.

Off-Line Recirculation Cooling Loop: Desired temperature is the oil temperature entering the cooler. In this case, the oil temperature change must be determined so that the actual oil leaving temperature can be found.

Calculate the oil temperature change (oil ΔT) with this formula:

$Oil \Delta T = (BTU's/HR) / (GPM \text{ Oil Flow} \times 210)$

To calculate the oil leaving temperature from the cooler, use this formula:

$Oil \text{ Leaving Temp.} = Oil \text{ Entering Temp.} - Oil \Delta T$

This formula may also be used in any application where the only temperature available is the entering oil temperature.

Oil Pressure Drop: Most systems can tolerate a pressure drop through the heat exchanger of 20 to 30 PSI. Excessive pressure drop should be avoided. Care should be taken to limit pressure drop to 5 PSI or less for case drain applications where high back pressure may damage the pump shaft seals.

Oil Temperature

Typical operating temperature ranges are:

Hydraulic Motor Oil	110° - 130°F
Hydrostatic Drive Oil	130° - 180°F
Bearing Lube Oil	120° - 160°F
Lube Oil Circuits	110° - 130°F

Selection Procedure

C_v Viscosity Correction

Average Oil Temp °F	OIL				
	SAE 5 110 SSU at 100°F 40 SSU at 210°F	SAE 10 150 SSU at 100°F 43 SSU at 210°F	SAE 20 275 SSU at 100°F 50 SSU at 210°F	SAE 30 500 SSU at 100°F 65 SSU at 210°F	SAE 40 750 SSU at 100°F 75 SSU at 210°F
100	1.14	1.22	1.35	1.58	1.77
150	1.01	1.05	1.11	1.21	1.31
200	.99	1.00	1.01	1.08	1.10
250	.95	.98	.99	1.00	1.00

Curve	Model	TEFC Motor Frame Size
1	RM-08-1	48-184
2	RM-08-2	48-184
3	RM-08-4	48-184
4	RM-19-1	213-256
5	RM-19-2	213-256
6	RM-24-1	254-286
7	RM-24-2	254-286
8	RM-24-1	324-365
9	RM-24-2	324-365

Oil Pressure Correction

